



Vert exaggeration = 5.0 Datum = 38.0

LENGTH (m)	30.467	5.962	51.250	93.676
GRADIENT (1:X)	1:18.5	1:29.8	1:120.0	1:34.5
COVER LEVEL (m)	44.680	42.830	42.830	42.380
INVERT LEVEL (m)	43.125	41.480 41.140	41.280 41.280	40.853 40.853

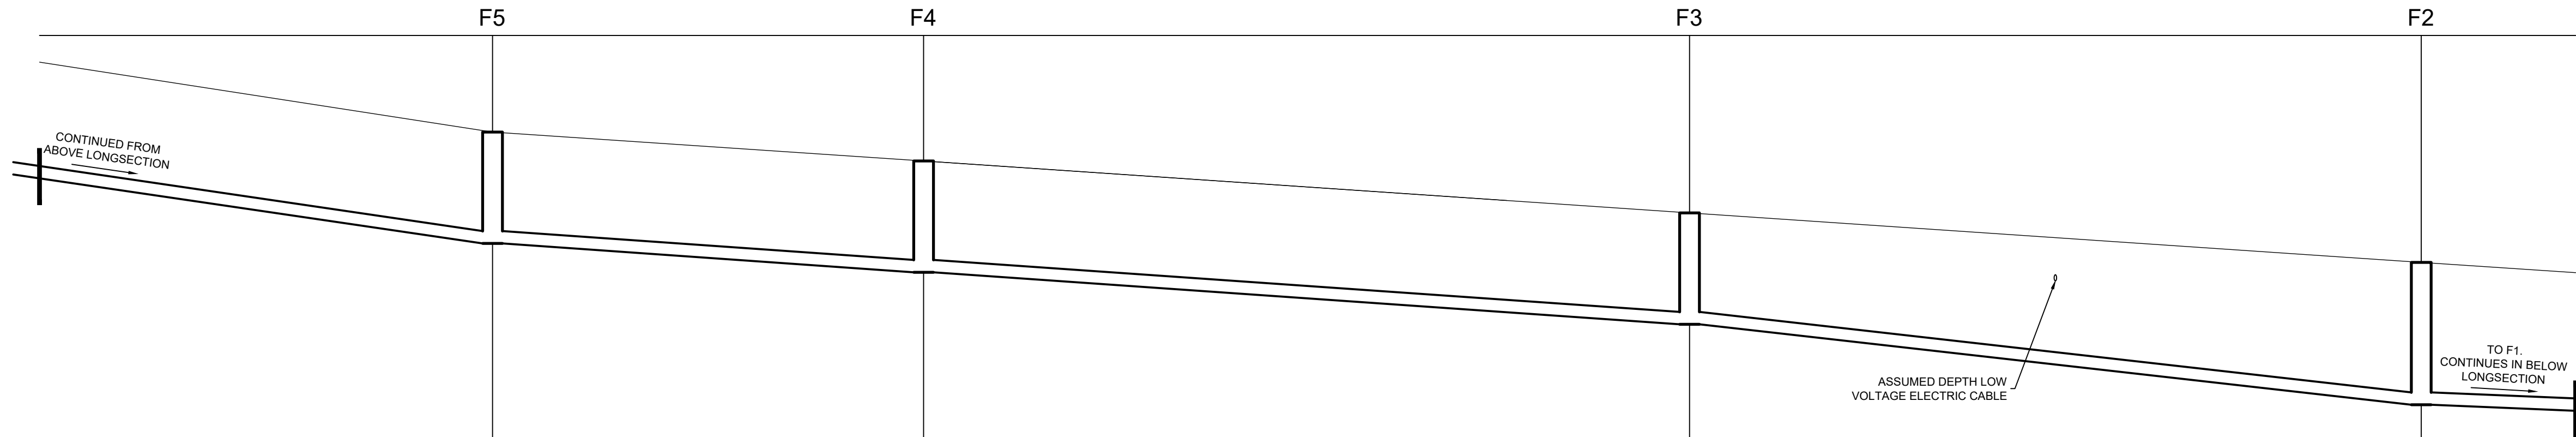

Vert exaggeration = 5.0 Datum = 35.0

LENGTH (m)	26.152	46.469	44.393
GRADIENT (1:X)	1:74.7	1:73.8	1:45.5
COVER LEVEL (m)	39.490	39.140	38.510
INVERT LEVEL (m)	38.140 38.140	37.790 37.790	37.160 37.160

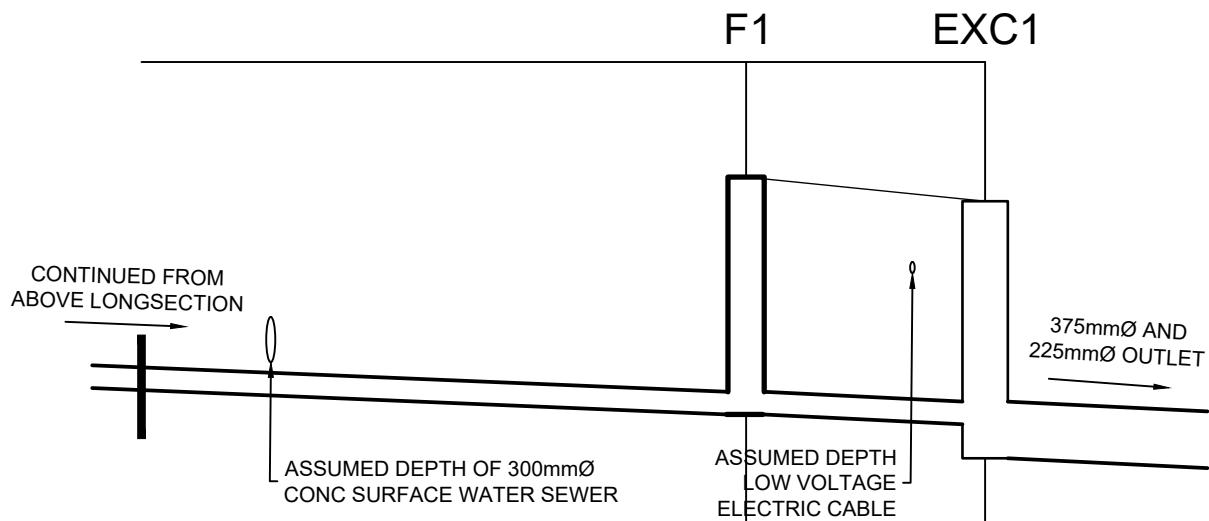

Vert exaggeration = 5.0 Datum = 35.0

LENGTH (m)	29.364	7.905
GRADIENT (1:X)	1:120	1:120
COVER LEVEL (m)	37.520	37.360
INVERT LEVEL (m)	35.950 35.950	35.885 35.885

- NOTES
- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECT'S, ENGINEER'S AND OTHER SPECIALISTS' DRAWINGS.
 - PLEASE REFER TO DATRYS DRAWING 24169/SK501-1 FOR DRAINAGE LAYOUT.
 - AT ALL OUTFALL POINTS TO AN EXISTING NETWORK, THE POSITION AND INVERT LEVEL OF EXISTING DRAINS MUST BE CONFIRMED WELL IN ADVANCE OF THE PROGRAMMED DATE FOR INSTALLING ANY OF THE UPSTREAM DRAINAGE, OR ORDERING ANY MATERIALS IN ORDER TO ALLOW TIME FOR ANY NECESSARY REVISIONS TO THE HYDRAULIC DESIGN.
 - THE DEVELOPER MUST SELF-VET AND CERTIFY THAT THE DESIGN CRITERIA, MATERIAL STANDARDS AND WORKMANSHIP SPECIFICATION FOR THE PROPOSED ADOPTABLE SEWERS ARE IN ACCORDANCE WITH THOSE SET OUT IN 'SEWERS FOR ADOPTION 7th EDITION AND THE REQUIREMENTS OF DCWW AS THE STATUTORY SEWERAGE UNDERTAKER, AND THE WELSH MINISTERS BUILD STANDARDS

REV	DATE	DESCRIPTION	BY	CHK	APP

PRELIMINARY



PROJECT
Tyddyn Fletcher,
Llanberis Road, Caernarfon.

TITLE
Offsite Foul Longsection

Caernarfon:
Unit 1 Block C, Doc Victoria
Caernarfon, LL55 1TH
Tel: 01286 671027

Mold:
Suite 4A, Broncoed House
Wireham Road, Mold, C17 1JHP
Tel: 01352 706205
info@datrys.coop | www.datrys.net

DRAWN CB	CHECKED AC	PASSED AC
DATE 07.10.24	DATRYS REF.	
SCALE AT A1 1:250	AUTOCAD REF. 24169/SK501	
DRAWING No. 24169/SK511	REVISION P1	